

NMI Allocation Procedure

Contents

Version release history.....	3
1 Introduction	4
1.1 Purpose	4
1.2 Scope	4
1.3 Roles and responsibilities	4
1.4 References	5
1.5 Definitions	5
1.6 Appendices	7
1.7 Records.....	7
1.8 Review.....	7
2 Principles.....	8
2.1 Source of NMIs.....	8
2.2 Allocation of NMIs	8
2.3 The NMI is to be allocated to the following metering installations.	8
2.4 Registration and NMI Data	8
2.5 NMI structure	9
2.6 NMI checksum	9
2.7 NMI data stream suffix	9
2.7.1 Import and export suffix allocation.....	9
2.8 NMI allocation at the wholesale market boundary	10
2.9 NMI Allocation	10
2.10 NMI rules.....	10
2.11 Examples	11
Appendix A: NMI Source.....	12
Appendix B: NMI Structure.....	14
Appendix C: NMI Checksum.....	16
Appendix D: NMI data stream suffix	22
Appendix E: NMI allocation to metering installation types	26
Appendix F: Examples for the allocation of NMIs	27
Examples for interval metering installations	27
Examples for accumulation metering installations (type 6).....	39
Contact	43

Version release history

Version	Date	Comments
1	7 March 2016	Initial version for consultation
1.0	23 May 2016	Approved version following consultation. Minor changes made to Appendix A for on-grid IES meters <i>NMI</i> block per power system.
1.1	3 February 2017	Updated: - Reference to 'settlement point' removed in response to feedback. - Appendix A typo corrections on <i>NMI</i> block numbers (now end in ...9) - Diagram F1.13 unbundled into F1.13A and F1.13B for ease of recognition of the variations. - Diagrams F2.1, F2.2 & F2.4 typical application added. - Diagrams F2.3, F2.5 & F2.6 not used in <i>NT</i>. Diagrams retained for consistency with the <i>NEM</i>.
1.2	6 February 2017	Approved version
1.3	28 August 2026	Administrative/non-material changes only, ie accessibility and updating logos

Document preparation and effective date

Prepared by:	NT Electricity System & Market Operator
Version:	1.3
Effective date:	28 August 2026
Status:	Approved

Approved for distribution and use by

Approved by:	Matthew Phillips
Title:	Manager Wholesale Market Services
Date:	28 August 2026

1 Introduction

1.1 Purpose

The purpose of this procedure is to specify the key principles to be adopted by the *Network Operator* for allocation of *NMIs* to *metering installations* in the *NT* electricity supply industry, and the key principles to be adopted by the *Market Operator* for the registration of those *NMIs*.

1.2 Scope

This document applies to:

- The allocation of *NMIs* to *metering installations* in all electricity supply regions, as well as major and minor centres in the *NT*. The *NMI* is to uniquely identify:
- a metering installation in the network where a meter is used to measure the flow of electricity (either into, across or out of the network);
- an agreed metering installation for non-metered loads that are billed by a retailer to a customer;
- The *I-NTEM* and the *NTEM* (as it is currently understood);
- The initial purpose built settlements system for the *I-NTEM* for its life span;
- The *AEMO* Market Settlements And Transfer Solution ('MSATS') at the time it is introduced into the *I-NTEM* or the *NTEM*.

For the removal of doubt:

- The *UMI* will be superseded by the *NMI* at all customer locations in the *NT*.
- The *NMI* does not uniquely define a *connection point*, even though there are a number of *connection points* with only one metering installation and hence one *NMI*.
- There may be more than one metering installation at *connection point*, and this principle should be preserved when defining the *NMI* relationship. That is, *NMIs* are not to be allocated solely for the purpose of uniquely identifying network *connection points*.
- If the principle of embedded networks is adopted in the *NT*, the allocation *NMIs* to *metering installations* in that network will follow the principles in this procedure. That is, there will be no unique identifier for the embedded network.

1.3 Roles and responsibilities

Role / Title	Responsibility
Executive General Manager Core Operations	• Approve this procedure. • Ensure that this procedure is complied with during its application.

Role / Title	Responsibility
Senior Manager Electricity and Market Reform	• Prepare and maintain the procedure. • Consult on the procedure when it is prepared and at any time it is substantially changed so that the <i>NMI</i> allocation process represents an arrangement agreed by <i>I-NTEM</i> Market Participants and other regional participants. • Implement the procedure in regard to the registration of <i>NMIs</i> against <i>metering installations</i> at <i>connection points</i>.
Senior Manager Metering Strategy (Metering Coordinator)	• Implement the procedure to ensure that all <i>metering installations</i> have a <i>NMI</i>, subject to a reasonable plan to transition from the <i>UMI</i> to the <i>NMI</i>.
Stakeholders	• Adopt the <i>NMI</i> as the unique reference to a metering installation for the purpose of customer transfers.

1.4 References

No.	Document	Date	Location
1	Systems Control Technical Code v5 (2015)	23/05/2016	D2015/414673
2	<i>NMI</i> Procedure (<i>NEM</i>)	August 2009	AEMO website
3	<i>NMI</i> Allocation List, v8 (<i>NEM</i>)	December 2014	AEMO website
4	Retail Supply Code	1 June 2013	UC Website
5	Electricity Networks (Third Party Access) Act	1 July 2015	UC Website

1.5 Definitions

The definitions of words recorded in the Glossary of the System Control Technical Code apply to this document, in addition to the words recorded in the table below, as shown in *italics* throughout the document.

Word	Definition
AEMO	Australian Energy Market Operator
Connection point	The point at which electricity is transferred to or from an electricity network. A <i>connection point</i> can be an entry point to or an exit point from a network, as defined in the Electricity Networks (Third Party Access) Code.

Word	Definition
<i>I-NTEM</i>	Interim Northern Territory Electricity Market. The Electricity Market in the Darwin – Katherine power system that commenced in May 2015.
<i>Market Operator</i>	The <i>NT</i> entity that manages the wholesale exchange of electricity based on the System Control Technical Code. <i>Power and Water</i> is the <i>Market Operator</i> in the <i>I-NTEM</i> .
<i>Metering installation</i>	The assembly of components including the instrument transformer, if any, measurement element(s) and processes, if any, recording and display equipment, communications interface, if any, that are controlled for the purpose of metrology and which lie between the <i>metering point</i>(s) and the point at or near the <i>metering point</i>(s) where the energy data is made available for collection. Notes: (1) The assembly of components may include the combination of several <i>metering points</i> to derive the metering data for a <i>connection point</i>. (2) The metering installation must be classified as being for revenue purposes and/or as a check metering installation. (3) An unmetered <i>connection point</i> in accordance with schedule 7.2 does not require a meter; it is nevertheless considered as having a metering installation.
<i>Metering point</i>	The point of physical connection of the device measuring the flow of electricity in the power conductor.
<i>NEM</i>	National Electricity Market
<i>Network Operator</i>	The Power Networks business unit within the <i>Power and Water</i> Corporation for the <i>NT</i> .
<i>NMI</i>	A National Metering Identifier as described in clause 7.3.1(d) of the National Electricity Rules.
<i>NT</i>	Northern Territory
<i>NTEM</i>	Northern Territory Electricity Market – a future upgrade of the <i>I NTEM</i> market design
<i>Power and Water (PWC)</i>	The <i>Power and Water</i> Corporation
<i>Service point</i>	The physical point of service of a network; a term used interchangeably with the term <i>connection point</i> within the <i>Power and Water</i> enterprise systems.
<i>Stakeholders</i>	Market Participants and System Participants

Word	Definition
UMI	The unique identifier assigned to an exit point by a network provider, as stated in the Retail Supply Code. Commonly referred to as the Unique Metering Identifier’.

1.6 Appendices

- Appendix A: *NMI* source
- Appendix B: *NMI* structure
- Appendix C: *NMI* checksum
- Appendix D: *NMI* data stream suffix
- Appendix E: *NMI* allocation to metering installation types
- Appendix F: Example for the allocation of *NMIs*

1.7 Records

This procedure is to be stored in *Power and Water’s* Records Management System (TRIM) in accordance with the Document and Record Control Procedure.

1.8 Review

This document is to be reviewed no later than three years, or more frequently as required by the *Market Operator*.

2 Principles

The following principles are to be used to guide the allocation of the *NMI* in the *NT*:

2.1 Source of NMIs

- *NMIs* are available as a block from *AEMO* for use in the *NT* (refer to Appendix A '*NMI* source' for details).
- The block of numbers is to be assigned by the *Market Operator* to each of the *NT* electricity supply power systems in accordance with the list provided in Appendix A.

2.2 Allocation of NMIs

The *Network Operator* must issue for each metering installation a unique *NMI*.

For the removal of doubt:

- There may be more than one metering installation at any one *connection point*. Consequently, there may be more than one *NMI* at any one *connection point*.
- Any one metering installation may be formed from an assembly of the components from two or more standalone metering installations.

2.3 The NMI is to be allocated to the following metering installations.

- *Metering installations* that contain interval meters.
- *Metering installations* that contain accumulation meters.
- *Metering installations* that do not contain a meter but are to be used in the wholesale settlements process (for example, street lights).
- *Metering installations* at wholesale market boundary points.
- *Metering installations* at customer *connection points*.
- *Metering installations* in embedded networks.

2.4 Registration and NMI Data

The *Network Operator* must register each metering installation (and its *NMI*) that has been allocated to a generator, a retailer or a customer with the *Market Operator*.

The following information must be provided to the *Market Operator*:

- *NMI*;
- Address, including street identifiers and postcode;

- The identity, characteristics and serial numbers of the *metering installation* components¹ (such as meter, instrument transformers, modem);
- Loss Factor Code;
- Embedded network parent and child names (if any);
- Network node identifier (being: generator, bulk *connection point* or customer, as the case may be).

For the removal of doubt, Power Networks within PWC will perform the following roles in the *NT*. This information is not required to be recorded against the *metering installation* at the time of registration:

- Metering Coordinator.
- Metering Provider.
- Metering Data Provider.

2.5 NMI structure

The *NMI* is a basic ten numeric digit number. The *NMI* may be used in conjunction with other identifiers or suffixes, which are explained in Appendix B '*NMI Structure*'.

2.6 NMI checksum

A one digit checksum feature must be used to reduce the occurrence of incorrect transfers attributable to manual data entry errors. This feature is explained in Appendix C '*NMI checksum*'.

2.7 NMI data stream suffix

From any one *metering installation* there could be multiple data streams². The number of data streams at a *connection point* increases when multiple *metering installations* are registered at that location. The accurate identification of data streams is explained in Appendix D '*NMI data stream suffix*'.

2.7.1 Import and export suffix allocation

For the purpose of assigning the correct characters for import and export to a *NMI* suffix, the energy flow directions are to be followed³:

- Import is where electricity enters a network, either from a source of generation or from another network – it is assigned the first suffix character B.

¹ As determined by the Market Operator from time to time.

² For example, import and export data streams for both kWh and KVarh.

³ A diagrammatic representation of this principle can be found in Section 15 of the AEMO NMI Procedure.

- Export is where electricity exits a network, either to a load or to another network – it is assigned the first suffix character E.

2.8 NMI allocation at the wholesale market boundary

NMI allocation at the wholesale market boundary⁴. At the boundary between the wholesale market network and a distribution network, there are two different types of *connection points*. One is a physical point and the other is a virtual point⁵.

- The physical *connection point* must have a physical *metering installation*, and hence a *NMI*.
- The virtual *connection point* will be established by the *Market Operator* to allow a customer's *metering installation* to be referred to that point (under certain circumstances⁶) for the purpose of settlements. A virtual *connection point* will also be assigned a *NMI*, which is different to that assigned to the physical *metering installation*.
- The *Market Operator* will request the *Network Operator* to allocate a *NMI* to the *metering installation* that will be assigned to the virtual connections point.

2.9 NMI Allocation

NMIs are to be allocated differently in accordance with the requirement to use check *metering installations* in certain situations. The treatment of *NMIs* when both master and check *metering installations* are deployed are explained in Appendix E '*NMI allocation to metering installation types*'.

2.10 NMI rules

The following rules are to apply to the use of a *NMI*:

- The *Network Operator* must register the basic ten digit *NMI* with the *Market Operator*.
- The Metering Data Provider must add appropriate identifiers to the end of the *NMI* (suffix) to enable the *Market Operator* to identify the characteristics of the data stream collected from any one meter. These identifies are explained in Appendix D '*NMI data stream suffix*'.
- Whilst a customer may elect to change its retailer, the *NMI* at the *connection point* remains assigned to the *metering installation*.
- Whilst a customer may move in and out of a premise that contains a *NMI*, there will be no change to that *NMI* at that premise.

⁴ The wholesale market boundary is the set of agreed points of supply that distinguish the interface between the wholesale market and the rest of the market, being the points of supply that are utilised by the Market Operator for settlements of the I-NTEM and the NTEM in accordance with the System Control Technical Code.

⁵ Also known as 'logical' in the NEM.

⁶ This will be activated if the I-NTEM (or subsequent design changes) adopts the settlements by differences technique used by the NEM for transacting metering data in the market.

- A *NMI* cannot be reused or assigned to another *connection point*, other than for the following conditions:
 - When a *NMI* is assigned to a builder's temporary supply, the *NMI* may be re-used on the permanent supply once the building work has been completed.
 - If there is a consolidation of metering (eg. change from 3 meters to 2 meters) or a relocation of the meter box without changes to the location of the measurement transformers the *NMI* will remain unchanged.
 - A reconstruction of the customer service connection (eg. overhead changed to underground) in which the two services are not concurrently operational, and without a change of the *connection point* to the network, does not require a change of *NMI*.
- All communications to and from Market Participants and the Metering Coordinator must include the *NMI*.
- Transfer of all meter data to the *Market Operator* must be in an agreed format that includes *NMI* identification.

2.11 Examples

Examples for the allocation of *NMIs* are explained in Appendix F 'Examples for the allocation of *NMIs* to interval meters'.

Appendix A: NMI Source

A *NMI* is a basic ten digit number that can be expanded by adding designated suffixes to identify specified characteristics of the data streams within the *metering installation*.

AEMO has assigned the following series of numbers ('block') to the *NT* for use as *NMIs*⁷:

Description	Number
First <i>NMI</i> in the block	2500000000
Last <i>NMI</i> in the block	2509999999

The *Market Operator* is the custodian of this block of numbers.

The *Market Operator* has determined to assign the *NMI* block across the *NT* in the following way:

Location	NMI Range
Darwin – Katherine power system	2500000000 to 2500999999
Alice Springs power system	2501000000 to 2501999999
Tennant Creek power System	2502000000 to 2502999999
Yulara power system	2503000000 to 2503999999
Kings Canyon	2504000000 to 2504999999
Timber Creek	2505000000 to 2505099999
Elliott	2505100000 to 2505199999
Borroloola	2505200000 to 2505299999
Daly Waters	2505300000 to 2505399999
Ti Tree	2505400000 to 2505499999
Nhulunbuy	2506000000 to 2506099999
Alyangula	2506100000 to 2506199999
Jabiru	2506200000 to 2506299999
IES non-grid connected	2507000000 to 2507999999
Other	2508000000 to 2509999999

⁷ See 'NMI Allocation List, v8' on the AEMO website.

Note: in each of the above series of numbers, the following protocol is to be adopted in allocating *NMIs* to the wholesale market boundary and street lights.

- a. Wholesale market boundary: The first 1,000 numbers in the series is to be allocated to the wholesale market boundary *metering installations*. For example, in the Darwin – Katherine power system the group of numbers between and including 2500000000 and 2500000999.
- b. Street lighting: The last 10,000 numbers in the series is to be allocated to street lighting *metering installations*. For example, in the Darwin – Katherine power system the group of numbers between and including 2500990000 and 2500999999.
- c. IES grid connected customers: The block of 10,000 numbers that commence at 1000 in the series is to be allocated to the IES grid connected customer *metering installations*. For example, in the Darwin – Katherine power system the group of numbers between and including 2500001000 and 2500010999.

Appendix B: NMI Structure

The base *NMI* is ten characters. In some circumstances the *NMI* checksum is appended to the *NMI* to form an eleven-character *NMI*, or the two character *NMI* data stream suffix may be appended to form a twelve-character *NMI*.

The *NMI* checksum is not used with the data stream suffix because the data stream suffix is intended for use only with electronic data transfer, whereas the *NMI* checksum is intended for use during manual entry of data.

The key attributes of the *NMI* are:

- The *NMI* must embody only numeric characters, except as explicitly provided within this document, and must not contain spaces.
- Character letters 'O' and 'I' are not permitted in order to avoid confusion with numbers 0 and 1.
- Embedded characters or meanings should not be used in allocating *NMIs*.
- The *Network Operator* must:
 - only use the *NMIs* obtained from the *Market Operator*.
 - allocate a unique *NMI* to each *metering installation* in the *NT* for which it is responsible.
 - Not re-use a *NMI* that has been allocated to a *metering installation* when that installation is no longer active (or 'on-market').
 - maintain a register of all *NMIs* allocated to *metering installations*.
- The *Market Operator* must maintain a register of all 'on-market' *NMIs* within its market systems.

The relationship between the defined points at the boundary of a network is shown in diagram B1:

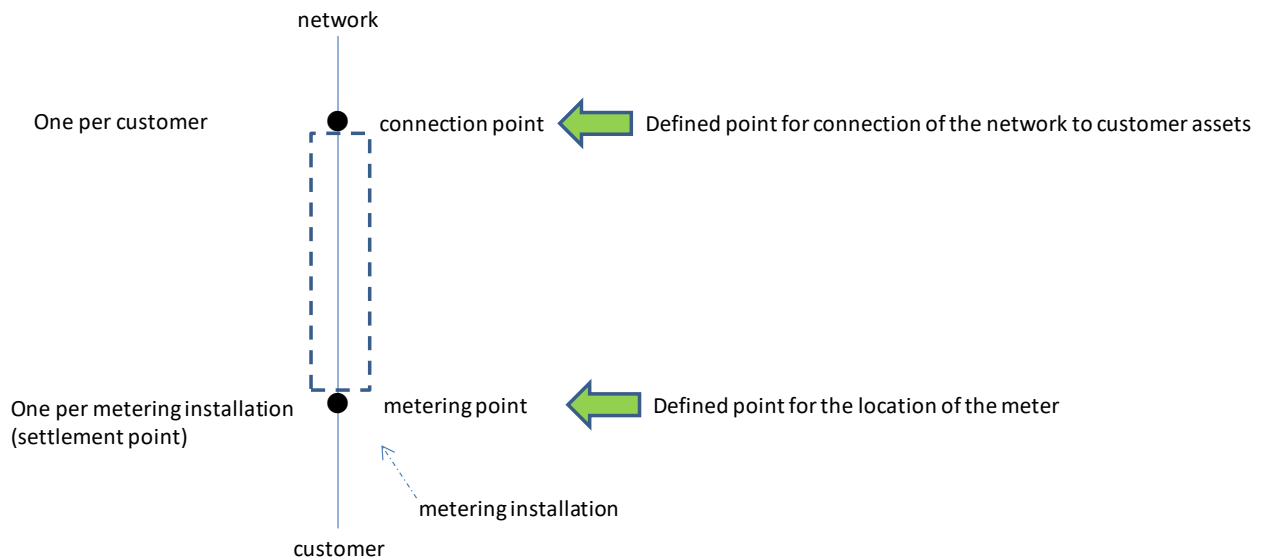


Diagram B1 – relationship between defined points at a network boundary

In the diagram the customer is responsible for the electricity used beyond the *connection point*. Consequently, the *metering point* should be shown co-incident with the *connection point*. However, in practice the *metering point* will be physically different to the *connection point*. The *metering installation* includes the *metering point* and the losses between the *metering point* and the *connection point*, as shown by the dashed box.

Appendix C: NMI Checksum

To reduce the occurrence of incorrect transfers attributable to *NMI* data entry errors, a one digit checksum has been implemented. The *NMI* checksum is a single numeral used to assist with data validation when the *NMI* is manually entered into a computer system. The *NMI* checksum is not used in conjunction with the *NMI* data stream suffix. However, when publishing a *NMI* for end-use customers the *NMI* will appear in its 11character format, and the checksum will be the final character of the *NMI*.

The *NMI* checksum is a mandatory field whenever a *NMI* is manually entered into the *Market Operator's* relevant market system.

Sample java code for an implementation of the checksum is provided in C1 below.

A general form of the algorithm used to create the *NMI* checksum is:

- Double the ASCII value of alternate digits within the *NMI* beginning with the right-most digit.
- Add the individual digits comprising the products obtained in step 1 to each of the unaffected ASCII value digits in the original number.
- Find the next highest multiple of 10.
- The check digit is the value obtained in step 2 subtracted from the value obtained in step 3.
- If the result of this subtraction is 10 then the check digit is 0.

A worked example of the algorithm is provided in C2 below.

The *NMI* checksum is always a numeric character.

The *NMI* checksum is not mandatory when transferring *NMI* identified data electronically between Participants and service providers. The checksum is focussed on applications where data entry occurs and there is a risk of character transposition, for example from paper to electronic systems or through an interactive telephone service.

C1: Sample java code for the NMI checksum:

```
/**
 * Calculates a LUHN-10.
 * <PRE>
 * 1. Double the value of alternate digits beginning with the rightmost digit
 * 2. Add the individual digits comprising the products obtained in step 1 to
 *    each of the unaffected digits in the original number.
 * 3. Find the next highest multiple of 10
```



```

* 4. The check digit is the value obtained in step 2 subtracted from the value
*   obtained in step 3.
* 5. END
* </PRE>
*/ public class LUHN10 {
/**
 * Value to indicate we have not calculated the luhn yet.
 */
private static final int NULL_VALUE = -1;
/**
 * Buffer holding the sequence of digits to use in the calculation.
 */
private StringBuffer _buffer;
/**
 * The cached value for the luhn.
 */ private int _luhn;
/**
 * Constructor.
 */
public LUHN10()
{
    reset();
}
/**
 * Resets the calculator to its initial values.
 */ public void reset()
{
    _buffer = new StringBuffer();
    _luhn = NULL_VALUE;
}
/**
 * Updates the LUHN-10 with specified digit.

```

```

*/ public void update(char d)
{
    // Append the character
    _buffer.append(d);
    // And, reset the cached luhn
    _luhn = NULL_VALUE;
}

/**
 * Returns the current LUHN-10 value.
 */
public int getValue()
{
    if (_luhn == NULL_VALUE)
    {
        int v = 0;
        boolean multiply = true;
        for (int i = _buffer.length(); i > 0; i--)
        {
            int d = (int)_buffer.charAt(i - 1);
            if (multiply)
            {
                d *= 2;
            }
            multiply = !multiply;
            while (d > 0)
            {
                v += d % 10;
                d /= 10;
            }
        }
    }
}

```

```

    }
}
_luhn = (10 - (v % 10)) % 10;
}
return _luhn;
}
public static void main(String[] args)
{
    if (args.length == 0)
    {
        System.out.println("USAGE: LUHN10 nmi");
    }
    else
    {
        LUHN10 luhn = new LUHN10();
        String nmi = args[0];
        for (int j = 0; j < nmi.length(); j++)
        {
            luhn.update(Character.toUpperCase(nmi.charAt(j)));
        }
        System.out.println(nmi + "/" + luhn.getValue());
    }
}
}
}

```

C2: Worked example of the NMI checksum java code:

This following worked example demonstrates the *NMI* checksum calculation. The logic of the algorithm can be summarised as:

- Process each character in the *NMI* individually, starting with the right most.
- For each character:

- Convert the character to its ASCII value
- For the right most character and each alternate character reading left, double the ASCII value obtained in Step 3 above.
- Add the individual digits of the ASCII value to a register holding the total added value for the Checksum.
- Subtract the total added value register from the next highest multiple of 10
- If the result is 10, the checksum is 0, otherwise the result is the checksum.

The *NMI* for the following worked example is 1234567890

Step 1. Initialise variables used by the process.

Double_This_Char is a boolean that indicates whether the character currently being processed should be doubled.

Char is the character currently being processed, as it appears in the *NMI*.

ASCII_Char is the ASCII value of **Char**

Total is the running sum of the digits generated by the algorithm.

Checksum is the final result.

At the start of the process: Double_This_Char = True because the right most character, and then every alternate character, is doubled by the algorithm. Total = 0 Checksum = NULL

Step 2. Read the *NMI* character by character, starting with the right most character.

Char = 0 [TotalBefore]

Step 3. Convert the character to its ASCII value.

ASCII_Char = 48

Step 4. Double the ASCII value if the character is the right most of the *NMI* or an alternate.

ASCII_Char = 96

Double_This_Char = Not Double_This_Char

Step 5. Add the individual digits of the ASCII value to the Total.

Total = TotalBefore + 9 + 6 (i.e. Total = 15)

Performing steps 2 through 5 for each character in our example *NMI* gives the following results:

Table C1: Example for NMI 1234567890

Character	Total Before	Ascii value	Double?	Doubled Value	Total After
0	0	48	Y	96	15 (0+9+6)
9	15	57	N	57	27 (15+5+7)
8	27	56	Y	112	31 (27+1+1+2)
7	31	55	N	55	41 (31+5+5)
6	41	54	Y	108	50 (41+1+0+8)
5	50	53	N	53	58 (50+5+3)
4	58	52	Y	104	63 (58+1+0+4)
3	63	51	N	51	69 (63+5+1)
2	69	50	Y	100	70 (69+1+0+0)
1	70	49	N	49	83 (70+4+9)

The value of **Total** after processing the entire *NMI* is 83.

The next highest multiple of 10 is 90.

Checksum = 90 – 83 = 7.

Appendix D: NMI data stream suffix

Settlement of the *I-NTEM* and other regions is reliant on the collection and delivery of metering data from initially ~3,000 *metering installations*, with the total rapidly growing up to ~100,000 *metering installations* as accumulation meters are converted to interval meters.

For any particular *metering installation* (and hence a given *connection point*) there may be multiple energy measurement elements and data recorders with multiple channels. Accurate identification of data streams is essential. The data stream suffix provides identification at the measurement element level for all data streams comprising the *metering installation* identified by the *NMI*.

The data stream suffix is a two character identifier used in conjunction with a ten digit *NMI* to identify a particular data stream associated with that *NMI* (making 12 characters in total). The data stream suffix allows differentiation of measurement quantities at a *metering point*, and differentiation of quantities between different measurement elements or registers for a *metering installation* at its *connection point*.

A twelve character *NMI* string identifies the *metering installation* (first ten characters) and associated data stream (data stream suffix as the last two characters).

The data stream suffix has retained alpha numeric characters because an all numeric structure could not accommodate the variety of data types or number of meters which may be required for the *metering installation*.

The data stream suffix is used when transmitting data between the *Market Operator*, *Market Participants* and the Metering Data Provider within the *NT* – it is not used in conjunction with the *NMI* checksum. The data stream suffix allows the parties to identify data at a sub-*connection point* level and to identify the individual sources of meter data to maintain necessary data audit trails.

The following two sections and tables detail the usage of the characters comprising the data stream suffix.

Interval Metering Data

Interval Metering Data is metering data in trading intervals or sub-intervals of trading intervals. It may be sourced from *metering installations* type 1 to 5 or 7. Metering data from a type 6 *metering installation* which has been transformed through a profiling algorithm into trading intervals is also identified as interval metering data (such as is performed for the IES Communities where there is no statistical bulk meter at the entrance of the community).

Interval metering data is identified in the data stream suffix by a suffix first character that is alpha [A to H, J to N, P to Z].

Identifiers in the MASTER column are those used within the *NEM* – they will be utilised for the *I-NTEM*. Where check metering is required (type 1 & 2 *metering installations*), identifiers from the CHECK column are used for the check installation.

Where the data from the MASTER and CHECK installations has been averaged (due to the *metering installations* being identical) the AVE column identifiers are used. Where only the difference between import and export is required, the NET column identifiers are used.

NET data is not to be used in the *I-NTEM*, as the contributions from both import and export to the market are required for policy analysis.

Table D1: data stream suffices for interval metered data

Data stream	First Character – Ave	First Character – Master	First Character – Check	First Character – Net	Second Character
Import kWh	A	B	C	N	Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Export kWh	D	E	F	N	Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Import kAVrh	J	K	L	X	Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Export kVArh	P	Q	R	X	Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
KVAh	S	T	U		Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Power Factor Pf		G			Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Q metering Qh		H	Y		Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Par metering path		M	W		Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z
Volts (or V2h) or Amps (A2h)		V	Z		Meter numbers or measuring elements are to be 1–9 then A–H, J–N, P–Z

Where a meter has multiple measurement elements, the convention for the population of the second character of the data stream suffix is:

- Increment the second character by one if the first character is the same. For example, use E1 and E2 if both elements are export kWh, and B1 and B2 if they are both import kWh.

Use the same second character if the first character is different. For example, use E1 and B1 if they are export kWh and import kWh respectively.

- Example: 2500010101 E2 relates to Export kWh data from either meter no.2 (single element) or element 2 of meter no.1 (twin element) pertaining to the *connection point* having the assigned *NMI* of 2500010101. Refer to Appendix F1.4 & 1.5 for diagrammatic examples.

Accumulation Energy Data

Refer to the Table below:

If the first character of the data stream suffix is numeric [1 to 9] the attached data is accumulation energy data from a type 6 *metering installation*.

The data streams identified by characters 1 to 6 are active energy (kWh). Data streams identified with 7, 8, or 9 are as defined by the *Network Operator*.

Table D2: Data Stream suffixes for consumption energy data

Suffix	Register Description	Meter number
1	First register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
2	Second register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
3	Third register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
4	First control load register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
5	Second control load register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
6	Third control load register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
7	First <i>Network Operator</i> defined register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
8	Second <i>Network Operator</i> defined register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.
9	Third <i>Network Operator</i> defined register	Meter numbers are to be 1–2 then A–H, J–N, P–Z.

Examples:

- 2500012345 1A relates to accumulation energy data from meter A (the 10th meter at the installation), register 1 applicable to a *metering installation* with the *NMI* of 2500012345.

- 2500012346 43 relates to accumulation energy data from a controlled circuit register in the 3rd meter at the installation, the data pertaining to a *metering installation* with the *NMI* of 2500012346.

Appendix E: NMI allocation to metering installation types

In the *NT*, the following situations provide insight into the allocation of *NMIs* for the types of *metering installation* to be deployed:

Power stations:

The largest annual flow in electricity is measured at the Channel Island power station. In 2015, the quantity was ~80,000 MWhs (80 GWh). This quantity was shared by three line *metering installations*, one of which was close to a balanced (zero) flow for the year. Accordingly, and assuming that the remaining two *metering installations* measured equal portions, the maximum flow for each *metering installation* would be ~40 GWh. This quantity equates to a type 3 *metering installation*.

Generators whose annual electricity volume per *metering installation* is less than 100 GWh but equal to or more than 0.75 GWh (750 MWh) are subject to type 3 *metering installation* accuracy. There is no requirement to provide a check metering (or partial check metering) arrangement for this volume range. Consequently, a single *NMI* will be allocated to this *metering installation*.

Zone Substations:

The largest zone substation in the Darwin – Katherine power system has a capacity of 25 MW. At a load factor of 60% and two transformers, each with a *metering installation*, one of those *metering installations* would measure 66 GWh for a year, determined as follows:

Annual flow of electricity through one *metering installation*:

$$= 25/2 * 8,760 * 60\% / 1000 \text{ GWh}$$

$$= 66 \text{ GWh}$$

This quantity requires a type 3 *metering installation* per transformer. An annual volume of less than 100 GWh but equal to or more than 0.75 GWh requires only one master (revenue) *metering installation*. The *metering installation* would have a unique *NMI*.

As the annual volume per transformer is determined to be less than 100 GWh no requirement for a check metering arrangement is required.

Customers below 100 GWh:

For the full range of customers whose annual electricity volume is less than 100 GWh (down to zero MWh) there is no requirement to provide a check (or partial check) arrangement. Consequently, a single *NMI* will be allocated to this *metering installation*.

Appendix F: Examples for the allocation of NMIs

There are two categories of example; one for interval *metering installations* (section F1) and one for accumulation *metering installations* (section F2).

Figure 1 - The following legend is deployed throughout the examples:

Symbol:



connection point



transformer



Meter (1 phase or 3 phase). If 3 phase, can be 1 meter or 3 single phase meters.



twin element meter, each element having its own register



Two register meter with single measurement element




Open switch



circuit breaker




Closed switch



metering installation (in part)

Examples for interval metering installations


Figure 2 - Contestable customer, metered on the lower voltage side of the transformer

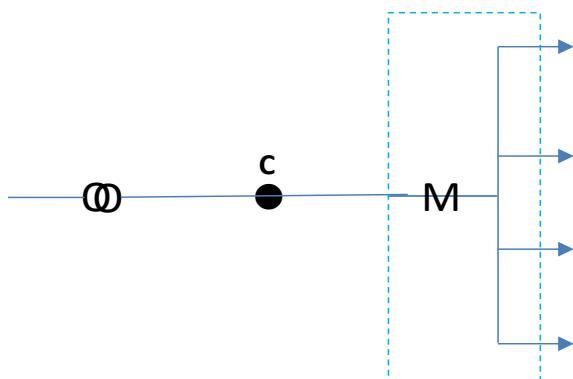

Attributes:

- One *connection point*
- One *metering installation*
- One meter (single measurement element)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream: 2500010101 E1


Figure 3 - Contestable customer, multiple metered on the lower voltage side of the transformer

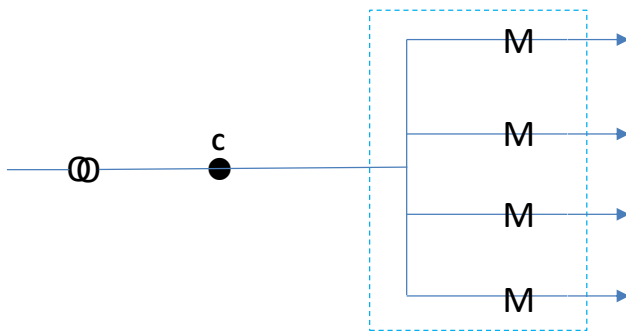

Attributes:

- One customer
- One *connection point*
- One *metering installation*
- Four meters (each with a single measurement element)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data streams: 2500010101 E1, 2500010101 E2, 2500010101 E3, 2500010101 E4


Figure 4 - Contestable customer, two tariff metering (general supply + off-peak) on the lower voltage side of the transformer

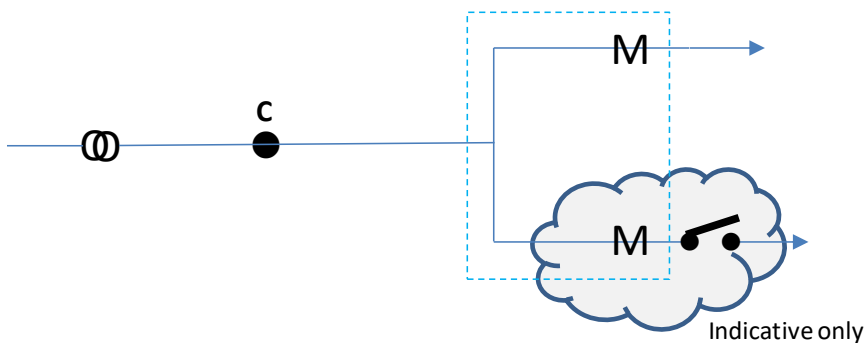

Attributes:

- One customer
- One *connection point*
- One *metering installation*
- One meter (single element) – no load control device
- One meter (single element) with a controlled load
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data streams: 2500010101 E1, 2500010101 E2


Figure 5 - Contestable customer, two controlled loads, one twin element meter

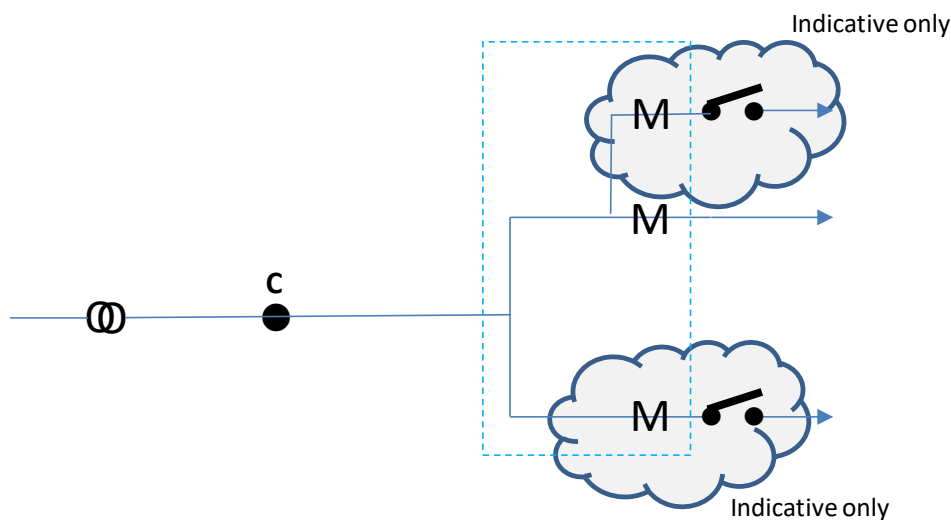

Attributes:

- One customer
- One *connection point*
- One *metering installation*
- One meter (twin element) with a controlled load
- One meter (single element) with a controlled load
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data streams: 2500010101 E1, 2500010101 E2, 2500010101 E3


Figure 6 - Contestable customer, two twin element meters

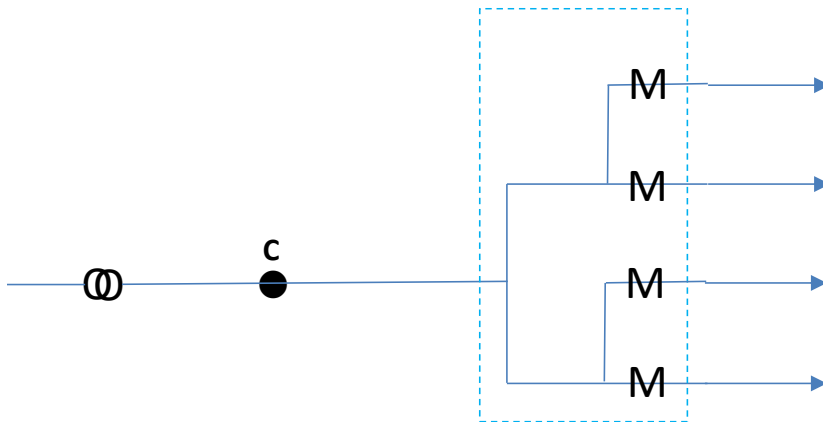

Attributes:

- One customer
- One *connection point*
- One *metering installation*
- Two meters (each with twin elements)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data streams: 2500010101 E1, 2500010101 E2, 2500010101 E3, 2500010101 E4

Figure 7 - Contestable customer, multiple meters on low voltage side of multiple transformers in the same substation

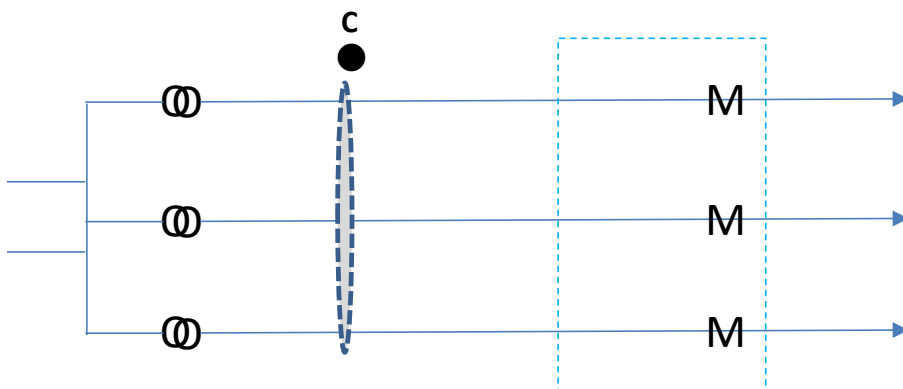


Attributes:

- One customer
- One *connection point* across three circuits
- One *metering installation* across three circuits
- Three meters (each with a single element)
- One *NMI*
- Allocated *NMI*: 2500010101

- Identity of collected meter data streams: 2500010101 E1, 2500010101 E2, 2500010101 E3


Figure 8 - Three contestable customers, metered on low voltage side of multiple transformers in the same substation building

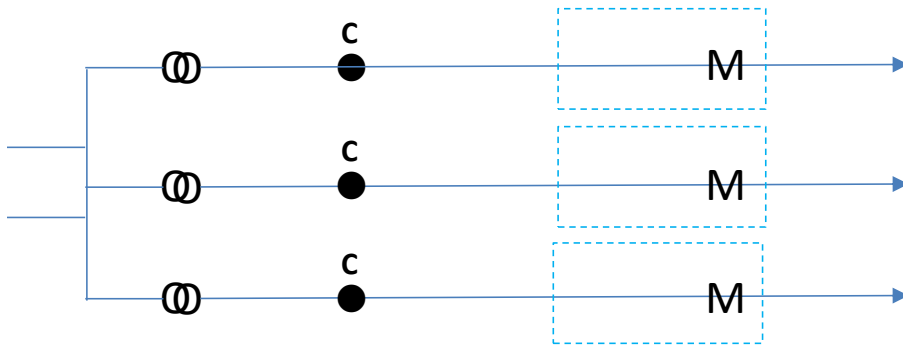

Attributes:

- Three customers
- Three *connection points*
- Three *metering installations*
- One meter (single element) per connection
- Three *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102, 2500010103
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1, 2500010103 E1


Figure 9 - Two contestable customers, two separate HV supplies to two separate substations, both metered on LV side

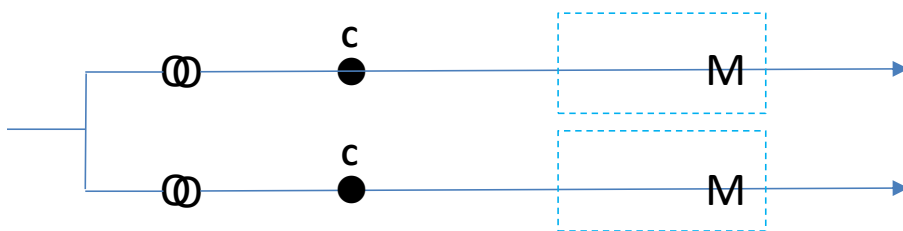

Attributes:

- Two customers
- Two *connection points*
- Two *metering installations*
- One meter (single element) per connection
- Two *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102
- Identify of collected meter data streams: 2500010101 E1, 2500010102 E1


Figure 10 - One contestable customer, two separate substations adjacent to each other or one single substation with two separate transformers, with a normally open point separating the high voltage supplies into two sources

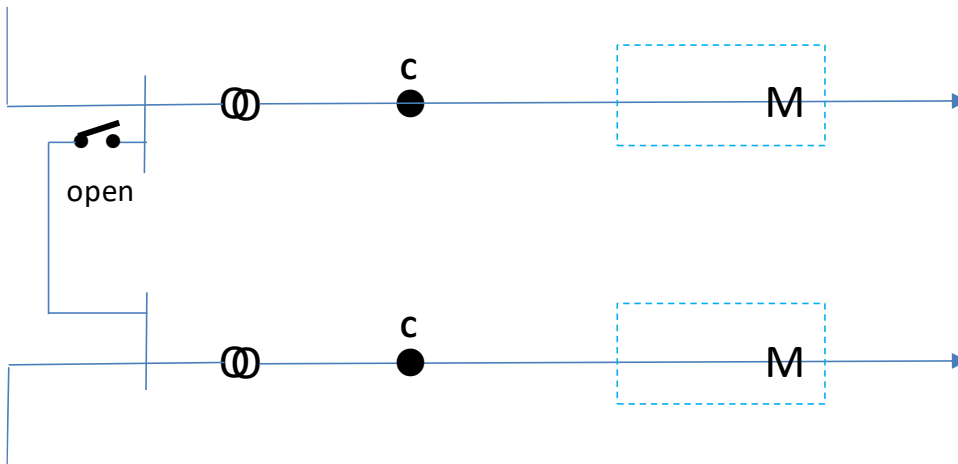

Attributes:

- One customer
- Two *connection points*
- Two *metering installations*
- One meter (single element) per connection
- Two *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1


Figure 11 - One contestable customer, two separate substations adjacent to each other or one single substation with two separate transformers, with the HV supply originating from a single source and LV switchboard in common switch room. This arrangement also applies to two separate substations not adjacent to each other but on the same premise

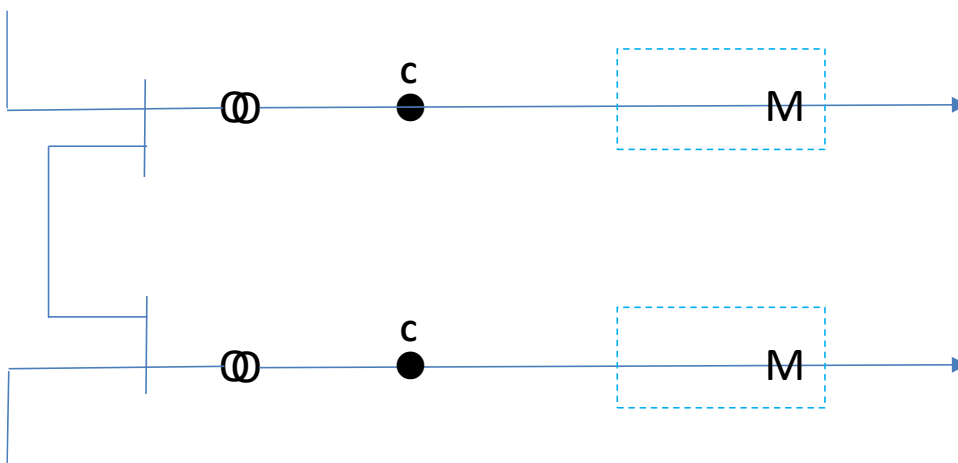

Attributes:

- One customer
- Two *connection points*
- Two *metering installations*
- One meter (single element) per connection
- Two *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1


Figure 12 - Multiple contestable customers, high rise buildings

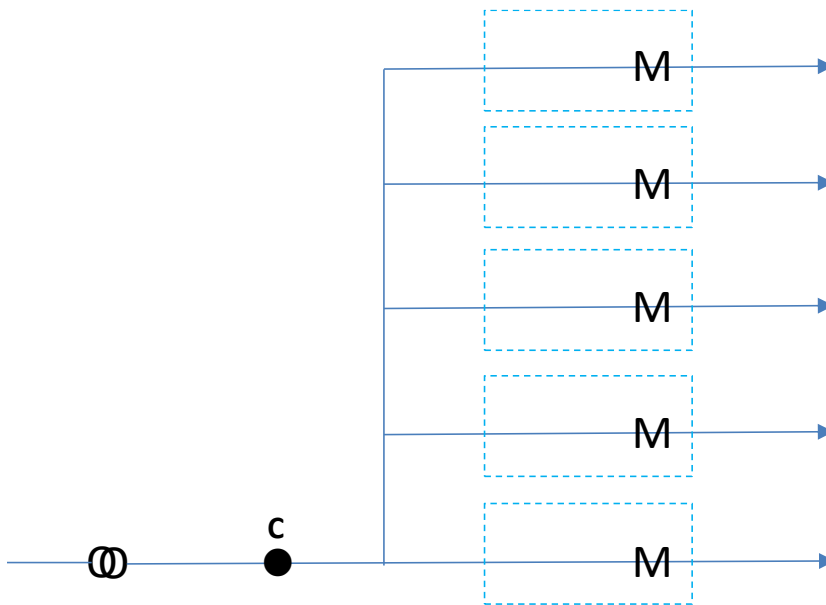

Attributes:

- Five customers
- One *connection point*
- Five *metering installations*
- One meter (single element) per installation
- Five *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102, 2500010103, 2500010104, 2500010105
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1, 2500010103 E1, 2500010104 E1, 2500010105 E1

Figure 13 - Multiple contestable customers, high rise buildings

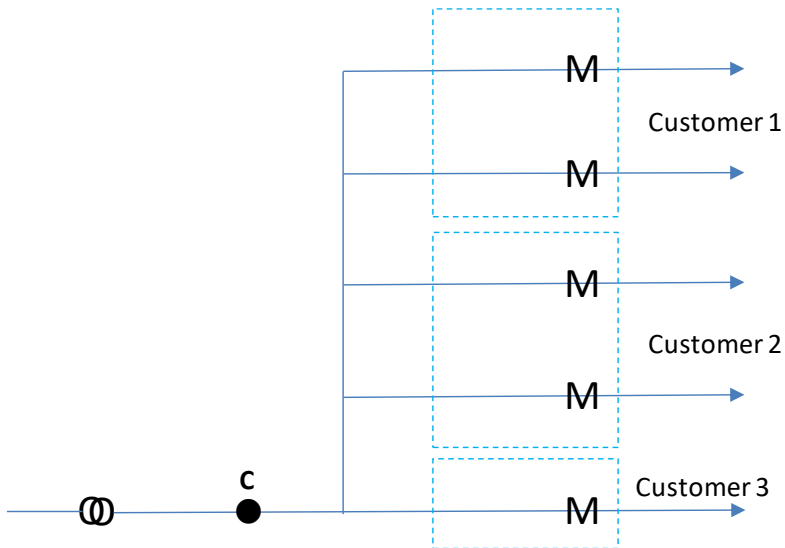

Attributes:

- Three customers
- One *connection point*
- Three *metering installations*
- One and two meters (single element) per installation
- Three *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102, 2500010103
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E2, 2500010103 E1, 2500010104 E2, 2500010105 E1


Figure 14 - One contestable customer with HV supply (eg: Barramundi Farm)



Attributes:

- One customer
- One *connection point*
- One *metering installation*
- One meter (single element)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data streams: 2500010101 E1


Figure 15 - One contestable customer with multiple supplies (eg: NT Casino HV and LV supply)

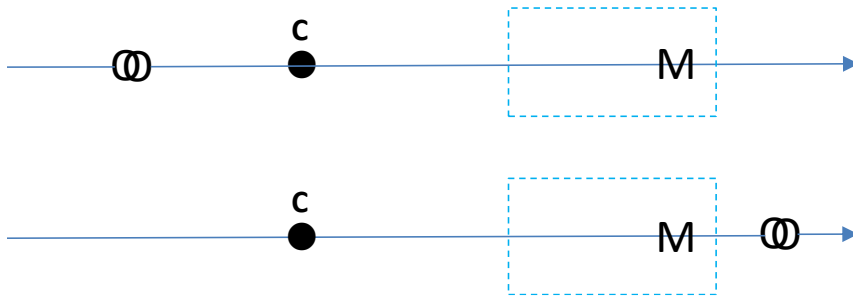

Attributes:

- One customer
- Two *connection points*
- Two *metering installations*
- One meter (single element) per installation
- Two *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1

Figure 16 - One contestable customer with standby supply (eg: Robertson Barracks, Darwin Airport HV supply)

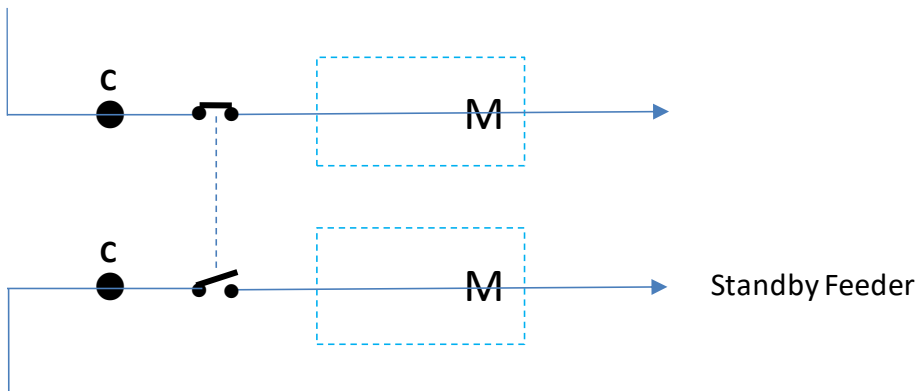


Attributes:

- One customer
- Two *connection points*
- Two *metering installations*
- One meter (single element) per installation
- Two *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1

Note: the 'standby supply may be a second or more permanently closed supply, implying that each supply will have its own *NMI*


Figure 17 - Wholesale market boundary – physical metering

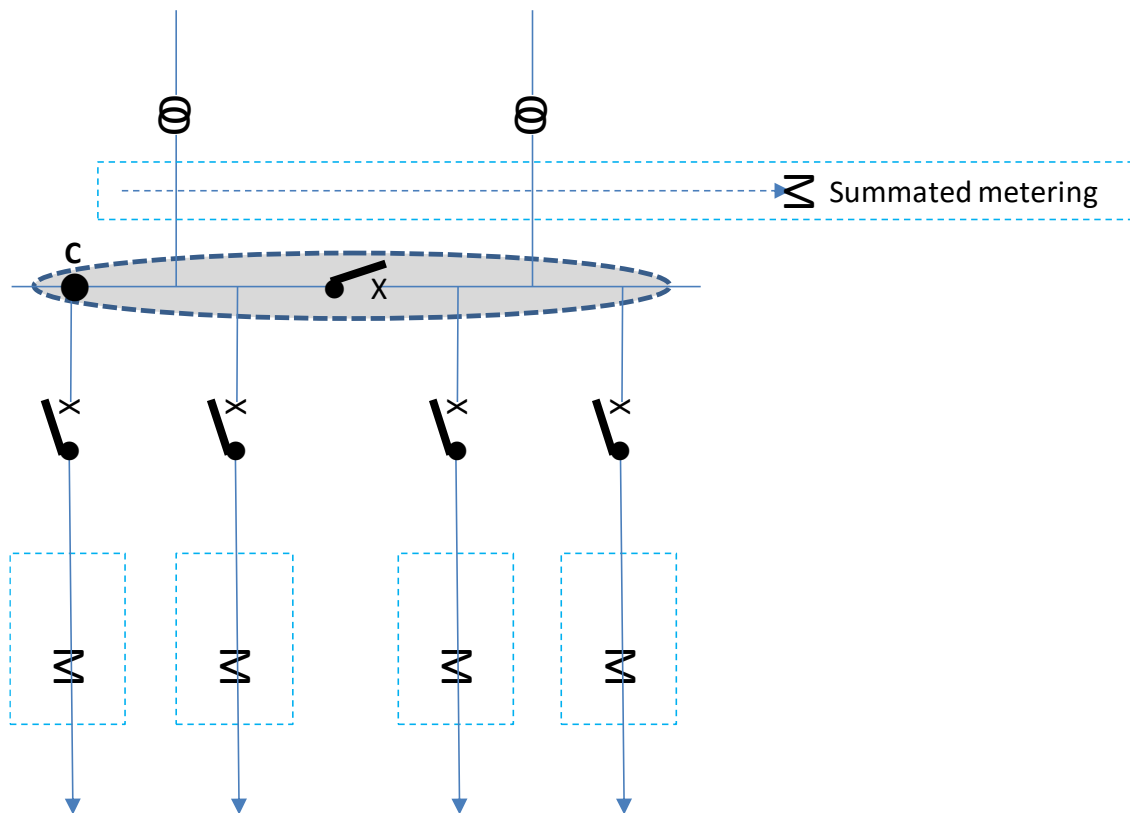

Attributes:

- One Market Participant or customer
- One *connection point*
- Five *metering installations* (including one check metering installation)
- One meter (single element) per installation
- Five *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102, 2500010103, 2500010104, 2500010105
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1, 2500010103 E1, 2500010104 E1, 2500010105 F1

Figure 18 - Wholesale market boundary – virtual metering

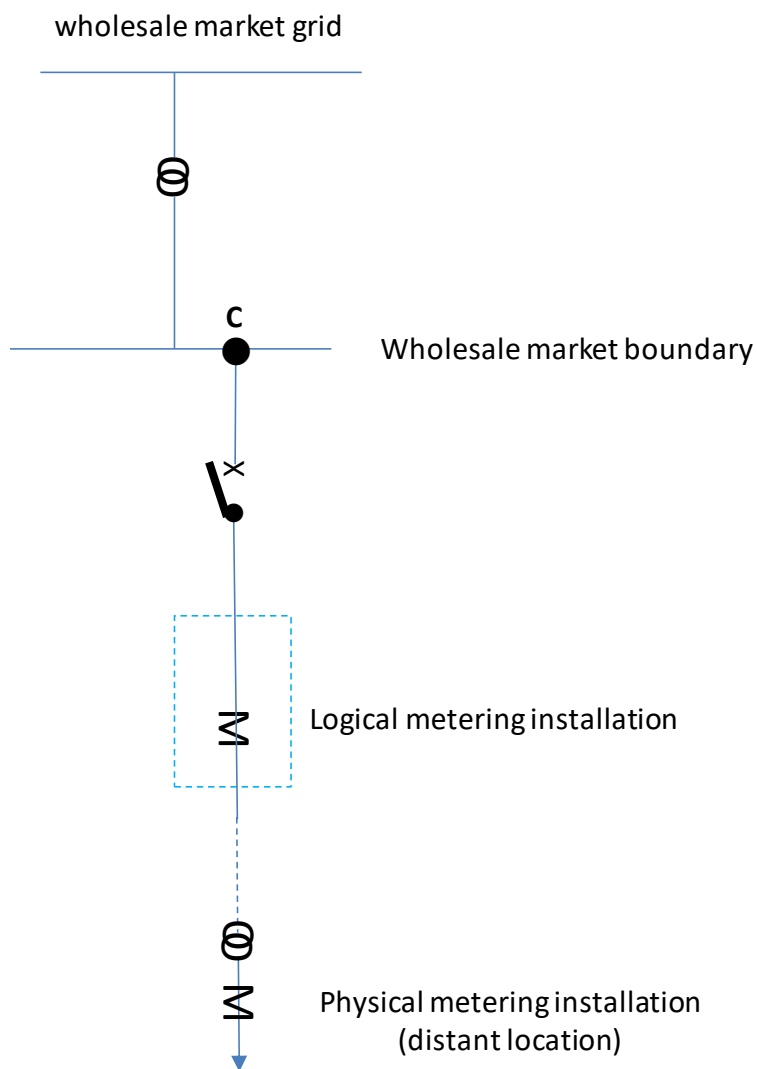


Attributes:

- One Market Participant or customer
- One *connection point*
- One *metering installation*
- One physical meter (single element) at distant location
- One logical meter (at wholesale boundary)
- Two *NMIs*
- Allocated *NMIs*: 2500010101, 2500010102
- Identity of collected meter data streams: 2500010101 E1, 2500010102 E1

The logical meter corrects the physical meter for line losses.


Figure 19 - Generating unit supply point at wholesale market boundary

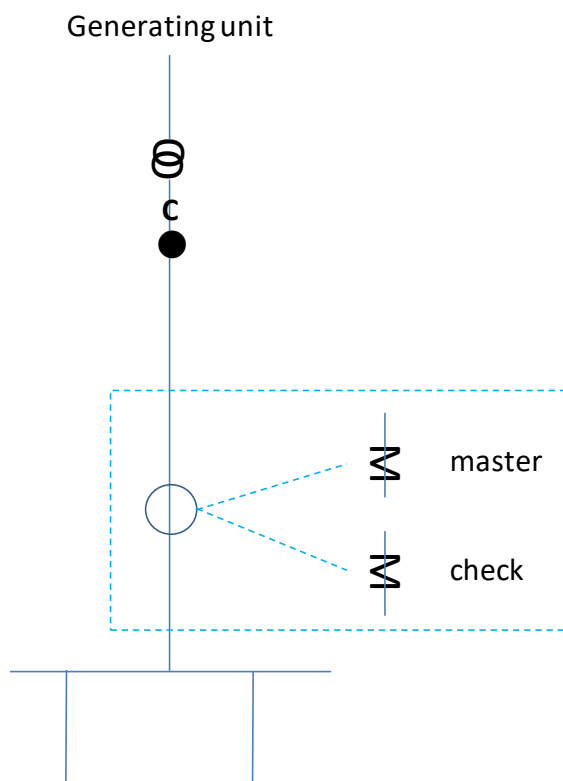

Attributes:

- One Market Participant
- One *connection point*
- Two *metering installations* (type 1)
- Two meters (single element), one for revenue and one for check
- Two *NMIs*
- Allocated *NMIs*: 2500010101
- Identity of collected meter data streams: 2500010101 B1 (master), 2500010101 C1 (check)

Figure 20 - Street lighting (type 7 metering installation)

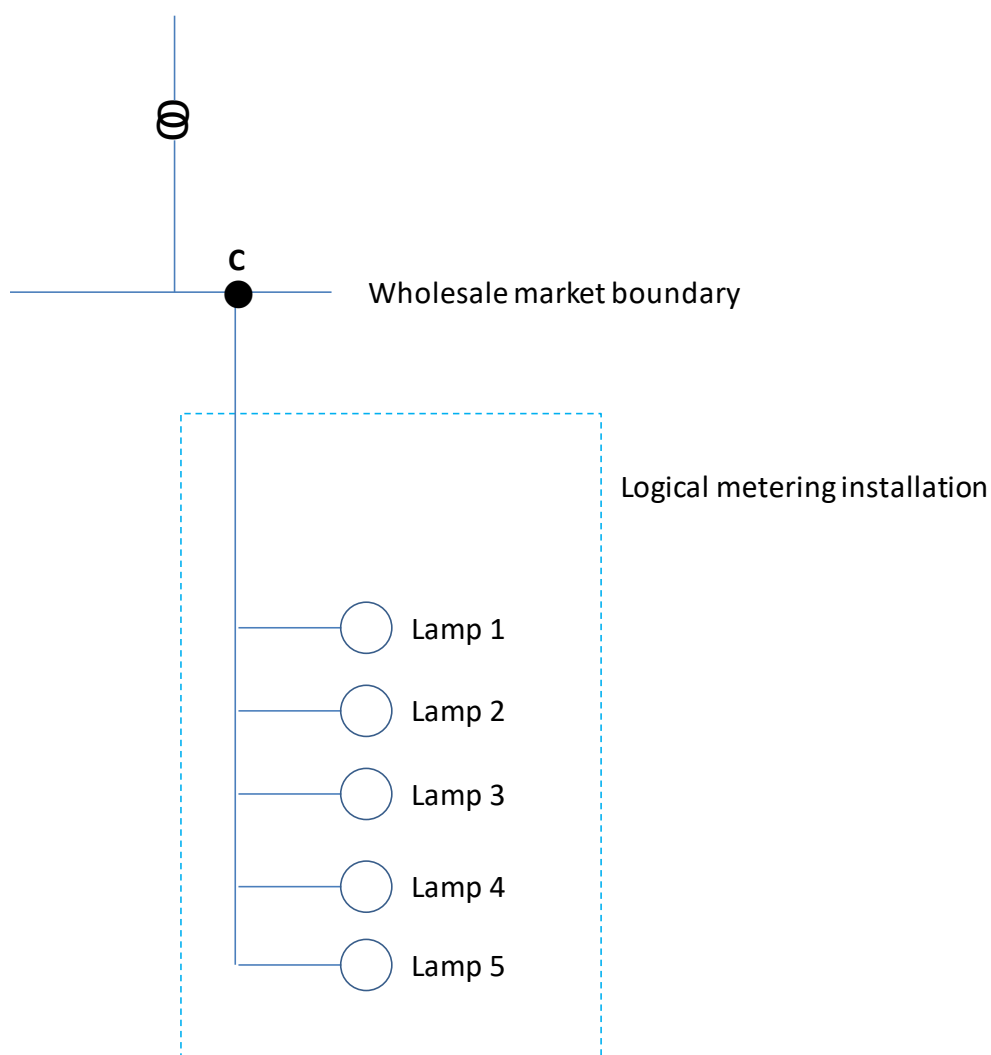


Attributes:

- One customer
- One *connection point*
- One *metering installations* (type 7)
- No meters (algorithm used in place of meters)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data streams: 2500010101 E1

Examples for accumulation metering installations (type 6)


Figure 21 - One customer, single meter with single register (*Domestic; small or large commercial / industrial*)

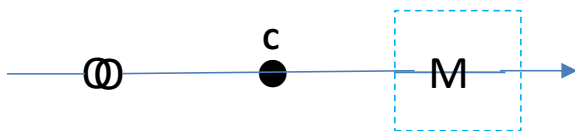

Attributes:

- One *connection point*
- One *metering installation*
- One meter (single measurement element)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream: 2500010101 11


Figure 22 - One customer, two meters with single register (*Domestic; small or large commercial / industrial*)

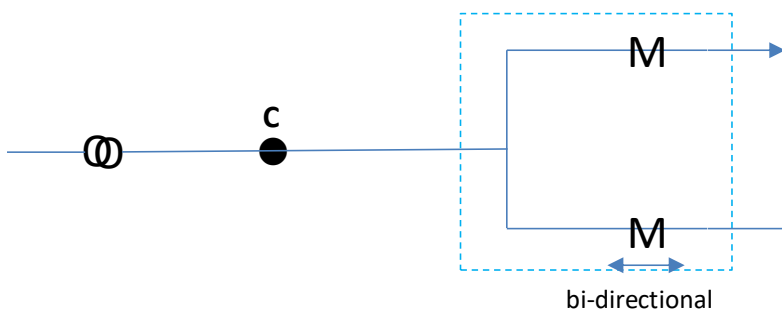

Attributes:

- One *connection point*
- One *metering installation*
- One meter (single measurement element)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream: 2500010101 11, 2500010101 12


Figure 23 - One customer, two meters with one assigned to a controlled load (*Not applicable in NT*)

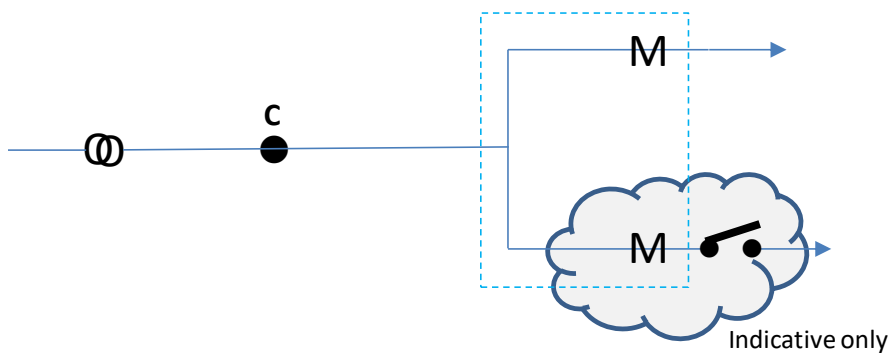

Attributes:

- One *connection point*
- One *metering installation*
- One meter (single measurement element) – no controlled load
- One meter (single measurement element) – with controlled load
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream: 250001010111, 2500010101 42


Figure 24 - One customer, two register meter with single measurement element (*Domestic; small commercial / small industrial*)

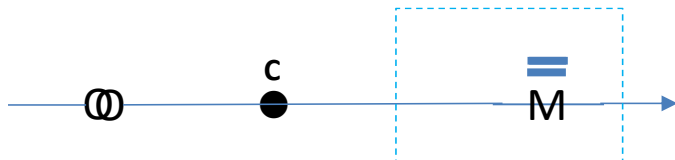

Attributes:

- One *connection point*
- One *metering installation*
- One meter (single measurement element) – with two registers
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream: 2500010101 11, 2500010101 21


Figure 25 - One customer, two multi-function meters (*Not applicable in NT*)

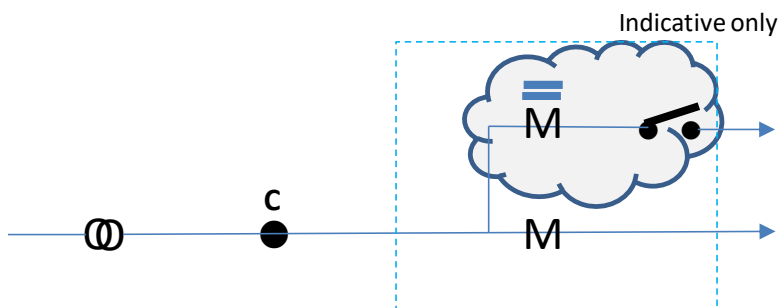

Attributes:

- One *connection point*
- One *metering installation*
- Two meters (each with two measurement elements and associated registers)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream (meter 1): 2500010101 11, 2500010101 41

Figure 26 - One customer, two multi-function meters (*Not applicable in NT*)

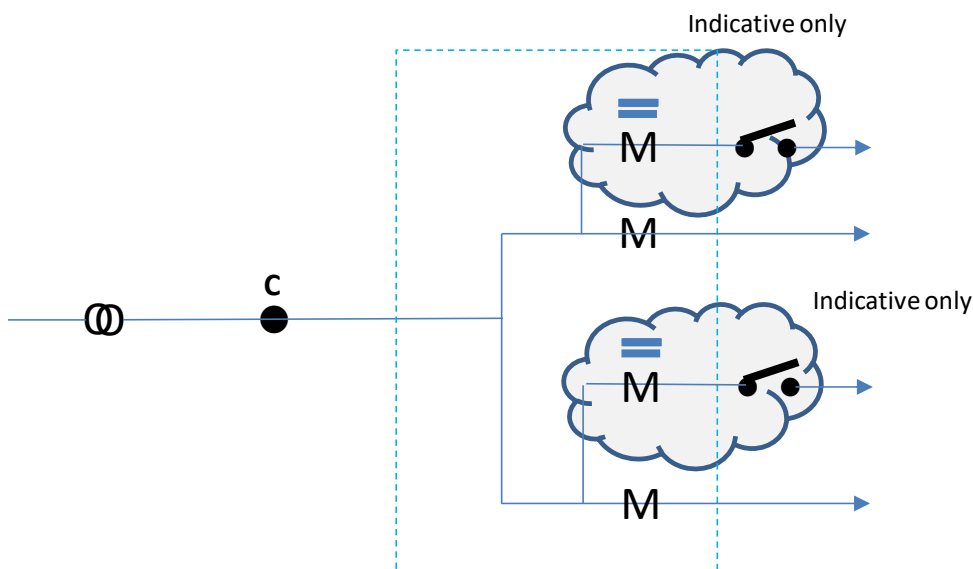

Attributes:

- One *connection point*
- One *metering installation*
- Two meters (each with two measurement elements and associated registers)
- One *NMI*
- Allocated *NMI*: 2500010101
- Identity of collected meter data stream (meter 1): 2500010101 11, 2500010101 41
- Identity of collected meter data stream (meter 2): 2500010101 12, 2500010101 42

NMI Allocation Procedure

Contact

Power and Water – 1800 245 092 from 8am to 5pm
weekdays.

Market Operator – 08 8985 7252

Email: market.operator@powerwater.com.au

NTESMO